→ Series 482

Pressure reducing valves made of stainless steel with flange connections

482





MATERIAL



SPECIFICATION





DN 15 to DN 100 - 20°C to + 120°C

up to 40 bar Outlet pressure: 0,5 to 15 bar depending on version

Inlet pressure:

SUITABLE FOR

Liquids	neutral and non-neutral	
Air, gases and vapours	neutral and non-neutral	\ge
Potable water cold	up to 40°C	
Potable water hot	up to 95°C	

EXAMPLES OF USE

For the protection of:

- domestic water supply systems

- commercial and industrial plants

against too high supply pressure.

Pressure reducers are used, if within a piping system despite of varying pressures on the inlet side a certain pressure must not be exceeded on the outlet side.

- potable water supply according to DIN 1988
- process water supply in industrial- and building technology
- fire-fighting equipment and sprinkler systems
- shipbuilding industry and offshore plants
- secondary areas in the food-, pharmaceutical- and cosmetics industries

APPROVALS DIN-DVGW type examination (up to 80°C) Type approval ACS Type approval WRAS (up to 85°C) Type approval PZH TR ZU 032/2013 - TR ZU 010/2011 Type approval ÜA (R-15.2.4-21-17231 Land Salzburg) Requirements DIN DVGW guidelines DIN EN ISO 3822 DIN EN 1567 DGR 2014/68/EU

DIN 1988	
Classification society	
DNV	DNV
Lloyd's Register EMEA	LR EMEA
American Bureau of Shipping	ABS
Bureau Veritas	BV
Russian Maritime Register of Shipping	RS
Registro Italiano Navale	RINA

MATERIALS

Component	Material	DIN EN	ASME
Inlet body	Stainless steel	1.4408	CF8M
Outlet body	Stainless steel	1.4408	CF8M
Internal parts	Stainless steel	1.4408	CF8M
	Stainless steel	1.4404	316 L
Spring	Spring steel with anti-rust protection	1.1200	ASTM A228
Strainer	Stainless steel	1.4404	316 L



	RSION										
m	with diaphra	agm		High-quality, heat-resistant moulded elastomere, fabric-reinforced diaphragm. Pressure adjustment by means of non-rising spindle. Valve insert with balanced single seat valve completely made of stainless steel.							
k	with piston				eel piston (only by means of no		e. Balanced sin	gle seat valve.			
Complete valve cartri	dge SP/HP (or	der code: 482 l	nsert-DNsea	al) available as r	eplacement pa	art can be excl	nanged without	removing the v	alve.		
Complete valve cartri	dge LP (order	code: 482 LP In	sert-DNsea	l) available as re	eplacement pai	rt can be exch	anged without r	emoving the va	lve.		
Built-in dirt trap made	of stainless s	teel.									
N/Loch cizo'	15 to DN 32 40 to DN 100	0,60 mm 0,75 mm									
		0,70 mm									
■ MEDIUM											
GF	gaseous and	d liquid		neutral gase	s; optionally w	ith FKM elast	non-sticking liq omere seals for uitable for stear	non-neutral m			
TYPE OF LIFTING	MECHANISM	И									
0	without lifti	ng device									
OUTLET PRESSUR	RERANGES										
SP	Standard ver	rsion			Inlet pressure: up to 16 bar (PN 16) or 40 bar (PN 40) Outlet pressure: from 1 to 8 bar						
HP	High-pressu (not for DN 6	ire version 65 and DN 80)			Inlet pressure: up to 16 bar (PN 16) Outlet pressure: from 5 t or 40 bar (PN 40) (5 to 13 bar, DN 100 with						
LP	Low-pressu (not for DN 6	re version 65, DN 80 and D	N 100)	Inlet pressur	e: up to 25 bar		Outlet pressure: from 0,5 to 2 ba				
AVAILABLE NOMI	NAL DIAME	TERS AND CO	NNECTION S	SIZES							
Nominal diameter DN	15	20	25	32	40	50	65	80	100		
Inlet / Outlet	15/15	20/20	25/25	32/32	40/40	50/50	65/65	80/80	100/100		
TYPE OF CONNEC	TION INLET	/ OUTLET FL	ANGE CONN	ECTIONS							
FCD2A / FCD2A	Flange conn	ection DIN EN 1	092-2 PN16 sea	aling strip form B	/ Flange conne	ection DIN EN 1	092-2 PN16 seal	ing strip form B			
FCD4A / FCD4A	Flange conn	ection DIN EN 1	092-2 PN40 sea	aling strip form B	/ Flange conne	ction DIN EN 1	092-2 PN40 seal	ing strip form B			
SEALS											
EPDM	Ethvlene pro	pylene diene		omere moulded d			–20°C to +120°C –20°C to +95°C (
EPDIVI	Langionio pro	1.7	appro	vals according t	o arinking wate	r uirective -		II UIII O DAI UUL	et pressur.		






■ NOMINAL DIAMETERS, CONNECTIONS, INSTALLATION DIMENSIONS

						-	•••••••••••••••••••••••••••••••••••••••				••••••
Series 482: Connection	n, instal	lation dimen	sions, range	s of adjustm	ent						
Connection		DN15 PN40	DN20 PN40	DN25 PN40	DN32 PN40	DN40 PN40	DN50 PN40	DN65 PN16	DN65 PN40	DN80 PN40	DN100 PN16
Inlet pressure SP, HP up to	bar	40	40	40	40	40	40	16	40	40	16
Inlet pressure LP up to	bar	25	25	25	25	25	25				
Outlet pressure	bar	0,5 — 2 1 — 8 5 — 15	1 – 8	1 – 8	1 – 8	1 – 8 5 – 13					
Installation	D	95	105	115	140	150	165	185	185	200	220
dimensions in mm	L	130	150	160	180	200	230	290	290	310	350
	H (H1)	102 (128 ¹)	130 (150 ¹)	130 (150 ¹)	130 (150 ¹)	165 (185 ¹)	165 (185 ¹)	235	235	235	320 (340 ³)
	H2 (H3)	124 (150 ²)	161 (181 ²)	161 (181 ²)	161 (181 ²)	198 (218 ²)	198 (218 ²)				
	h	46	50	55	68	73	80	89	89	96	112
	K /nxd	65/4xM12	75/4xM12	85/4xM12	100/4xM16	110/4xM16	125/4xM16	145/4xM16	145/8xM16	160/8xM16	180/8xM16
Pressure gauge connections Inlet pressure	G1							1/4" radial	1/4" radial	1/4" radial	1/4" axial
Pressure gauge connections Outlet pressure	G1	1/4" axial	1/4" radial	1/4" radial	1/4" radial	1/4" axial					
Weight	kg	2,7 (2,9 ¹)	3,9 (4,31)	4,3 (4,7 ¹)	5,5 (5,91)	8,4 (9,1 ¹)	10,2 (10,9 ¹)	18,7	19	20,5	37 (40 ³)
Coefficient of flow $K_{vs}^{\ 4}$	m³/h	3	5,8	6,7	7,6	12,5	15	25	25	26	80

¹for type 482mGFO-LP ²for type 482mGFO-LP S15 ³for type 482kGFO-HP ⁴The K_{vs} value was determined according to DIN EN 60534-2-3. Instructions on how to determine size and capacity are to be found under section 2.

■ MAIN DIMENSIONS, INSTALLATION DIMENSIONS

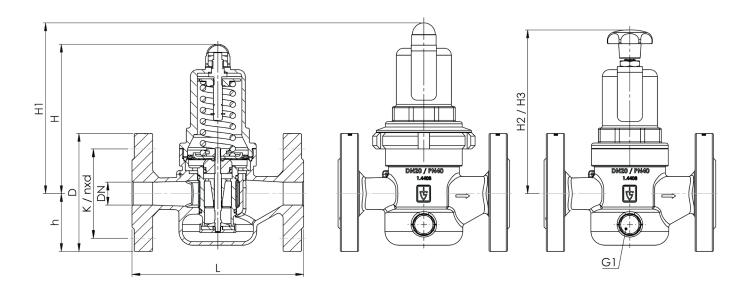



	Valve version	Medium	Lifting device	Outlet pressure	Nominal diameter	Connec	ction type	Conne	ction size	Seal	Options	Optional: fixed	Quar tity
					DN	Inlet	Outlet	Inlet	Outlet			setting	
482	m	GF	0	HP	50	FCD4A	FCD4A	50	50	EPDM			5
482	k	GF	0	HP	100	FCD2A	FCD2A	100	100	FKM	S71	7	2
482		GF	0										
482		GF	0										
■ PRO	PERTIES												
S15	Hand wheel	(plastic) for t	cool-free se	tting of setpre	ssure								
S17	Supply with r	manometers s	suitable for t	he valve finish									
S71	Preliminary s preset press		ection again	st manipulatio	n of the								
or nomir	nal diameters DI	N15 to DN50 o	utlet pressur	e ranges LP and	SP								
■ OPT	IONS												
GOX	of specific m production p	naterials inclu process, in no	uding oil- ar ominal sizes	ns by employn nd grease free DN15 - DN50 ure max. 60°C	1								
P01	Oil- and grea	ise-free produ	uction										
FE	Setting and s	sealing											Г
	TIFICATES / /	APPROVAL	S										
				4 2.2 (WKZ 2.)	2)		C05				SP 3, 3-A,), icate:		
CER	Factory cert		DIN EN 1020		2)		C05	Manufactur Please indio	rer certificat	tion of certif	icate:		
CER	Factory cert Test certifica	ificate acc. E Ite acc. DIN E : certificate a	DIN EN 1020 EN 10204 3.1				C05 C06	Manufactur Please indio ATEX evalu	rer certificati cate descript	tion of certif 2014/34/EU	icate:		
CER C01 C02	Factory cert Test certifica Material test (pressure ret	ificate acc. C Ite acc. DIN E certificate ac taining part) individual ins	DIN EN 1020 EN 10204 3.1 CC. DIN EN 1	(WPZ 3.1)			C05 C06 C10	Manufactur Please indio ATEX evalu Certificate Certification	rer certificat cate descript ation acc. to of oil- and gr n of the prod	tion of certif 2014/34/EU rease free p uction proce	icate:		
 CER[*] C01 C02 C03 	Factory cert Test certifica Material test (pressure ret TÜV/DEKRA i	ificate acc. C Ite acc. DIN E certificate ac taining part) individual ins	DIN EN 1020 EN 10204 3.1 CC. DIN EN 1	(WPZ 3.1) 10204 3.1 (MPZ			C05 C06 C10	Manufactur Please indio ATEX evalu Certificate Certification	rer certificat cate descript ation acc. to of oil- and gr n of the prod	tion of certif 2014/34/EU rease free p uction proce	icate: roduction ess especially		
CO1 CO2 CO3 CO4	Factory cert Test certifica Material test (pressure ret TÜV/DEKRA i	ificate acc. D Ite acc. DIN E certificate ac taining part) individual ins -APZ)	DIN EN 1020 EN 10204 3.1 cc. DIN EN 1 pection acc	(WPZ 3.1) 10204 3.1 (MPZ			C05 C06 C10	Manufactur Please indio ATEX evalu Certificate Certification	rer certificat cate descript ation acc. to of oil- and gr n of the prod	tion of certif 2014/34/EU rease free p uction proce	icate: roduction ess especially		
CO1 CO2 CO3 CO4	Factory cert Test certifica Material test (pressure ret TÜV/DEKRA (TÜV/DEKRA	ificate acc. D te acc. DIN E certificate ac taining part) individual ins -APZ) CCREDITAT	DIN EN 1020 IN 10204 3.1 cc. DIN EN 1 pection acc	(WPZ 3.1) 10204 3.1 (MPZ	2 3.1)		C05 C06 C10 C11	Manufactur Please indie ATEX evalu Certificate Certification ous oxygen	rer certificat cate descript ation acc. to of oil- and gr n of the prod	tion of certif 2014/34/EU rease free p uction proce s by employr	icate: roduction ess especially nent of speci		
 CER C01 C02 C03 C04 ADIV 	Factory cert Test certifica Material test (pressure ret TÜV/DEKRA (TÜV/DEKRA)	ificate acc. DIN E certificate ac individual ins -APZ) CCREDITAT mination acc cate/declara	DIN EN 1020 IN 10204 3.1 cc. DIN EN 1 pection acc TIONS . to Directiv tion with pa	(WPZ 3.1) 10204 3.1 (MPZ . EN 10204 3.2	2 3.1)		C05 C06 C10 C11 AK1	Manufactur Please indie ATEX evalu Certificate Certification ous oxygen Det Norske	rer certificat cate descript ation acc. to of oil- and gr n of the prod applications	tion of certif 2014/34/EU rease free p uction proce s by employr NV) type ap	icate: roduction ess especially nent of speci proval		
 CER C01 C02 C03 C04 ADM AA1 	Factory cert Test certifica Material test (pressure ret TÜV/DEKRA i (TÜV/DEKRA IISSIONS / A EC Type exat EAC - certifi and laser ma	ificate acc. D te acc. DIN E certificate ac taining part) individual ins -APZ) CCREDITAT mination acc cate/declara arking of the v	DIN EN 1020 IN 10204 3.1 cc. DIN EN 1 pection acc TIONS . to Directiv tion with pa valve	(WPZ 3.1) 10204 3.1 (MPZ . EN 10204 3.2 re 2014/68/EU	2 3.1) e valve		C05 C06 C10 C11 AK1 AK2	Manufactur Please indie ATEX evalu Certificate Certification ous oxygen Det Norske Lloyd's Reg	rer certificat cate descript ation acc. to of oil- and gr n of the prod applications e Veritas (Df gister (LR) ty	tion of certif 2014/34/EU rease free p uction proce s by employr NV) type ap ype approva	icate: roduction ess especially nent of speci proval	fic materials	
 CER¹ C01 C02 C03 C04 AA1 AA4 	Factory cert Test certifica Material test (pressure ret TÜV/DEKRA ISSIONS / A EC Type exai EAC - certifi and laser ma Deutscher V type approva	ificate acc. D te acc. DIN E certificate ac taining part) individual ins -APZ) CCREDITAT mination acc cate/declara arking of the ferein des Ga al	DIN EN 1020 IN 10204 3.1 cc. DIN EN 1 pection acc TIONS . to Directiv tion with pay valve s- und Was	(WPZ 3.1) 10204 3.1 (MPZ . EN 10204 3.2 re 2014/68/EU assport for the	2 3.1) e valve GW		C05 C06 C10 C11 AK1 AK2 AK3	Manufactur Please indie ATEX evalu Certificate Certification ous oxygen Det Norske Lloyd's Reg American I	rer certificat cate descript ation acc. to of oil- and gr n of the prod applications e Veritas (Df gister (LR) ty	tion of certif 2014/34/EU rease free p uction proce s by employr NV) type ap ype approva hipping (AB	icate: roduction ess especially nent of speci proval al S) type appr	fic materials	
 CER C01 C02 C03 C04 AA1 AA1 AA4 AB1 	Factory cert Test certifica Material test (pressure ret TÜV/DEKRA ISSIONS / A EC Type exal EAC - certifi and laser ma Deutscher V type approva	ificate acc. D te acc. DIN E certificate ac taining part) individual ins -APZ) CCREDITAT mination acc cate/declara arking of the ferein des Ga al ations and ac	DIN EN 1020 IN 10204 3.1 cc. DIN EN 1 pection acc TIONS . to Directiv tion with pay valve s- und Was	(WPZ 3.1) 10204 3.1 (MPZ . EN 10204 3.2 re 2014/68/EU assport for the serfaches, DV	2 3.1) e valve GW pe		C05 C06 C10 C11 AK1 AK2 AK3 AK4	Manufactur Please indie ATEX evalu Certificate Certification ous oxygen Det Norske Lloyd's Reg American I Bureau Ver	rer certificati cate descript ation acc. to of oil- and gu n of the prod applications e Veritas (DP gister (LR) ty Bureau of SI ritas (BV) ty aritime Regi	tion of certif 2014/34/EU rease free p uction proce s by employr NV) type ap ype approva hipping (AB pe approva	icate: roduction ess especially nent of speci proval al S) type appr	roval	
 CER¹ C02 C03 C04 AA1 AA1 AA1 AB1 AB2 	Factory cert Test certifica Material test (pressure ret TÜV/DEKRA ISSIONS / A EC Type exal EAC - certifi and laser ma Deutscher V type approva	ificate acc. D te acc. DIN E certificate ac taining part) individual ins -APZ) CCREDITAT mination acc cate/declara arking of the ferein des Ga al ations and ac	DIN EN 1020 IN 10204 3.1 cc. DIN EN 1 pection acc TIONS . to Directiv tion with pay valve s- und Was	(WPZ 3.1) 10204 3.1 (MPZ . EN 10204 3.2 re 2014/68/EU assport for the serfaches, DV eme WRAS typ	2 3.1) e valve GW pe		C05 C06 C10 C11 AK1 AK2 AK3 AK3 AK4 AK5	Manufactur Please indie ATEX evalu Certificate Certificate Ous oxygen Det Norske Lloyd's Reg American I Bureau Ver Russian M type appro	rer certificati cate descript ation acc. to of oil- and gu n of the prod applications e Veritas (DI gister (LR) ty Bureau of SI ritas (BV) ty aritime Regi val	tion of certif 2014/34/EU rease free p uction proce s by employr VV) type ap ype approva hipping (AB pe approva ister of Ship	icate: roduction ess especially nent of speci proval al S) type appr	roval	

■ ENQUIRY


Copy and send to: order@goetze.de.



Series 482:

Dimensioning by pressure loss on the outlet pressure side

Flow chart water

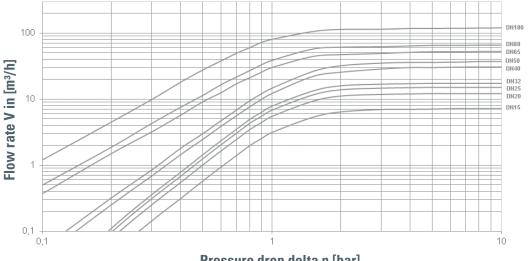

Pressure drop delta p [bar]


Dimensioning by flow velocity

For Liquids:


With help of the chart you can determine the nominal diameter (DN) for a given flow volume V (m³/h). According to DVGW-guidelines (DIN 1988) a flow velocity of 2 m/s in domestic water supply systems should not be exceeded.

For compressed air and other gaseous media:

The usual flow velocity for compressed air is 10 - 20 m/s. For gaseous media the flow volume V should always be shown in actual cubic meters/hour. If the flow volume is given in standard cubic meters, these should be converted into actual cubic meters before using the diagram.



Actual cubic meters are based on the prevailing pressure of the medium on the outlet side of the pressure reducer.

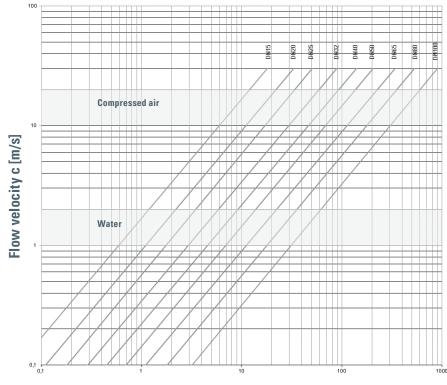

Flow volume V [m³/h]

